



**Underwriters
Laboratories Inc.®**

Northbrook Division
333 Pingsten Road
Northbrook, IL 60062-2096 USA
www.ul.com
tel: 1 847 272 8800

November 12, 2004

Specified Technologies Inc.
Mr. Jim Stahl, Jr.
200 Evans Way, Suite 2
Somerville, NJ 08876

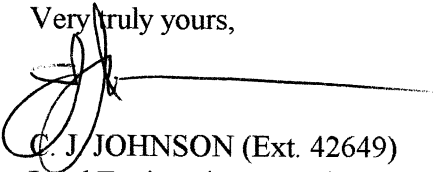
Our Reference: 04NK23894, R14288

Subject: W Rating for Through-Penetration Firestop Systems Incorporating
Pensil 300 Sealant

Dear Mr. Stahl:

This is to confirm that the testing has been completed on several critical through-penetration firestop systems incorporating the Pensil 300 Sealant. The purpose of the testing was to determine whether the systems would meet the Class 1 requirements when subjected to a head pressure test followed by fire exposure and hose stream tests conducted in accordance with the optional W Rating criteria being proposed as an addition to the Standard, Fire Tests of Through-Penetration Firestops, ANSI/UL 1479. Based on the successful results of the test investigation, in the near future we will be revising a number of firestop systems in the UL Fire Resistance Directory to include a Class 1 W Rating.

Very truly yours,


C. J. JOHNSON (Ext. 42649)
Lead Engineering Associate
Fire Protection Division, 3019B

