

System No. C-AJ-1048


F Rating - 3 Hr

T Rating - 1/2 Hr

L Rating At Ambient - Less Than 1 CFM/sq ft

L Rating At 400 F - Less Than 1 CFM/sq ft

W Rating - Class 1 (See Item 3B)

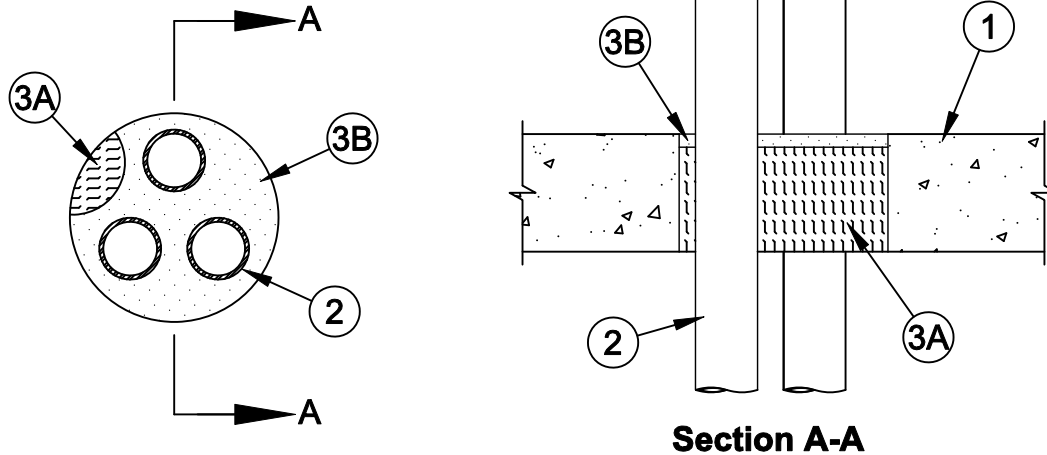

- Floor or Wall Assembly** - Min 4-1/2 in. (114 mm) thick reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg/m³) concrete floor or min 5 in. (127 mm) thick reinforced lightweight or normal weight concrete wall. Wall may also be constructed of any UL Classified **Concrete Blocks***. Max diam of opening is 8 in. (203 mm).
See **Concrete Blocks** (CAZT) category in the Fire Resistance Directory for names of manufacturers.
- Through Penetrants** - Three metallic pipes, conduits or tubing to be installed within the opening. The space between pipes, conduits or tubing shall be nom 1 in. (25 mm). The space between pipes, conduits or tubing and periphery of opening shall be min 5/8 in. (16 mm) to max 2-5/8 in. (67 mm). Pipe, conduit or tubing to be rigidly supported on both sides of floor or wall assembly. The following types and sizes of metallic pipes, conduits or tubing may be used:
 - Steel Pipe** - Nom 2 in. (51 mm) diam (or smaller) Schedule 5 (or heavier) steel pipe.
 - Conduit** - Nom 2 in. (51 mm) diam (or smaller) steel electrical metallic tubing or rigid steel conduit.
 - Iron Pipe** - Nom 2 in. (51 mm) diam (or smaller) cast or ductile iron pipe.
- Firestop System** - The firestop system shall consist of the following:
 - Packing Material** - Min 4 in. (102 mm) thickness of min 4 pcf (64 kg/m³) mineral wool batt insulation firmly packed into opening as a permanent form. Packing material to be recessed from top surface of floor or from both surfaces of wall as required to accommodate the required thickness of fill material.
 - Fill, Void or Cavity Material* - Caulk** - Min 1/2 in. (13 mm) thickness of fill material applied within the annulus, flush with top surface of floor or with both surfaces of wall.

MOMENTIVE PERFORMANCE MATERIALS - Pensil 100 Caulk for floors and walls.

SPECIFIED TECHNOLOGIES INC - Pensil 100 Sealant for floors and wall, Pensil 300 Sealant or SpecSeal Series SIL300 Sealant for floors and walls and Pensil 300 S/L Sealant or SpecSeal Series SIL300SL Sealant for floors only.

W Rating applies only when Pensil 300, Pensil 300 S/L, SpecSeal Series SIL300 or SpecSeal Series SIL300SL Sealants are used.

*Bearing the UL Classification Mark



Specified Technologies Inc. 210 Evans Way Somerville, NJ 08876

Reproduced courtesy of Underwriters Laboratories, Inc.

Created or Revised: November 26, 2008

(800)992-1180 • (908)526-8000 • FAX (908)231-8415 • E-Mail:techserv@stifirestop.com • Website:www.stifirestop.com



C-AJ-1048
PAGE 1 OF 1