




### System No. C-AJ-0014

(Formerly System No. 440)

F Rating - 3 Hr.

T Rating - 2 Hr.

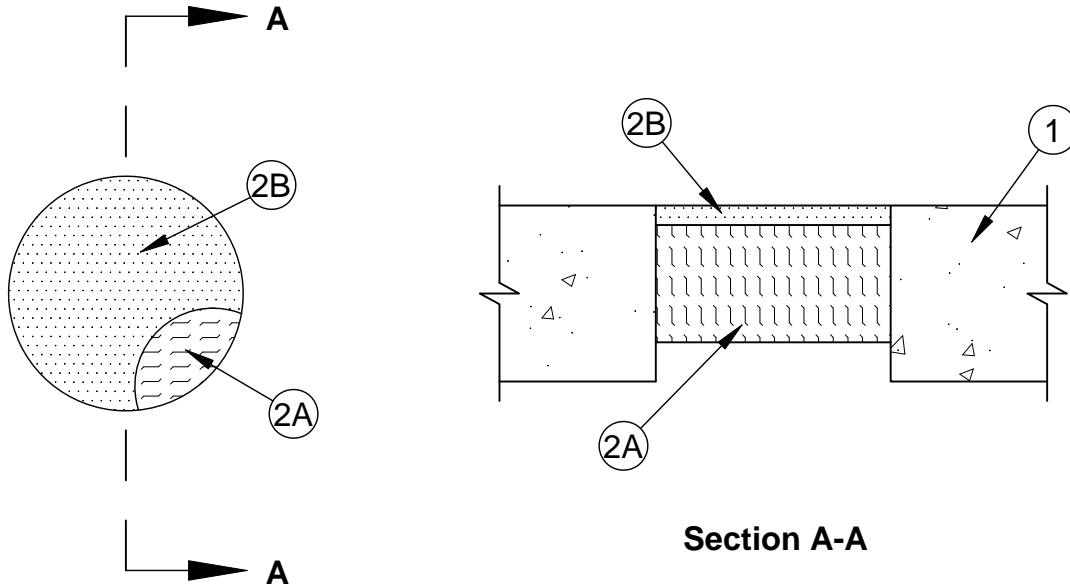

1. **Floor or Wall Assembly** - Min 4-1/2 in. thick lightweight or normal weight (100-150 pcf) concrete. Wall may also be constructed of any UL Classified **Concrete Blocks\***. Max diam of opening is 8 in.  
See **Concrete Block (CAZT)** category in the Fire Resistance Directory for names of manufacturers.
2. **Firestop System** - The firestop system shall consist of the following:
  - A. **Packing Material** - Min 1-1/2 in. thickness of min 6 pcf mineral wool batt insulation firmly packed into opening as a permanent form. Packing material to be recessed from top surface of floor or from both surfaces of wall as required to accommodate the required thickness of fill material.
  - B. **Fill, Void or Cavity Material\* - Sealant** - Min 1 in. thickness of fill material applied within the annulus, flush with top surface of floor or with both surfaces of wall.

**SPECIFIED TECHNOLOGIES INC** - SpecSeal Series SSS Sealant or SpecSeal LCI Sealant

\*Bearing the UL Classification Mark

**FOR CANADIAN APPLICATIONS:**  
When evaluated in accordance with ULC-S115, this system has the following ratings:

System No.	Rating Hr.			
	F	FT	FH	FTH
C-AJ-0014	3	2	3	2

For more information, please see the XHHW7.R14288 section in the UL Fire Resistance Directory entitled Fill, Void or Cavity Materials Certified for Canada.



**Specified Technologies Inc. 210 Evans Way Somerville, NJ 08876**

Reproduced courtesy of Underwriters Laboratories, Inc.

Created or Revised: October 09, 2009

(800)992-1180 • (908)526-8000 • FAX (908)231-8415 • E-Mail:techserv@stifirestop.com • Website:www.stifirestop.com



C-AJ-0014  
PAGE 1 OF 1