




System No. C-AJ-0113

F Ratings - 2, 3 and 4 Hr (See Items 1 and 3)

T Rating - 0 Hr

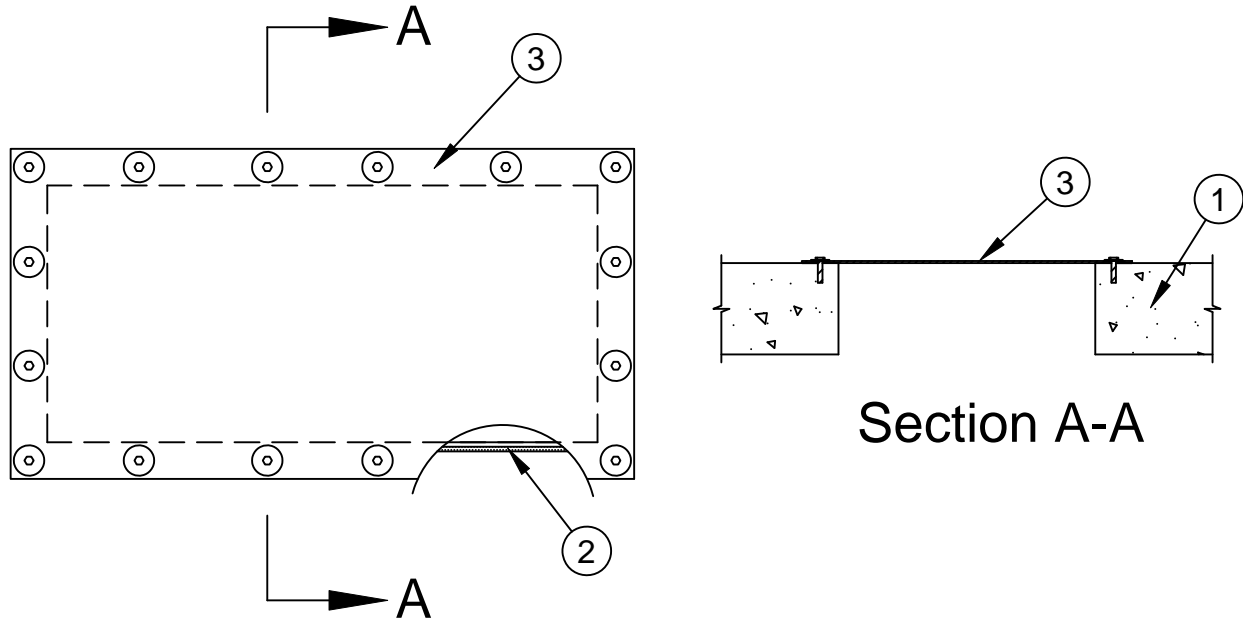

- 1. Floor or Wall Assembly** - Min 4-1/2 in. (114 mm) thick lightweight or normal weight (100-150 pcf or 1600-2400 kg/m³) concrete. Min thickness of floor or wall assembly to be 6 in. (152 mm) for 3 hr F Rating and 7-1/2 in. (191 mm) for 4 hr F Rating. Wall may also be constructed of any UL Classified **Concrete Blocks***. Max area of opening 900 sq in. (0.58 m²) with max dimension of 30 in. (762 mm) for 2 hr F Rating. Max area of opening 240 sq in. (0.15 m²) with max dimension of 24 in. (610 mm) for 3 and 4 hr F Ratings.

See **Concrete Blocks** (CAZT) category in the Fire Resistance Directory for names of manufacturers.

- 2. Fill, Void or Cavity Materials* - Putty or Sealant** - Nom 3/16 in. (5 mm) wide by 3/16 in. (5 mm) thick strip of putty or nom 1/4 in. (6 mm) diam bead of sealant applied beneath intumescent sheet around entire perimeter of through opening on surface of floor or wall.

SPECIFIED TECHNOLOGIES INC - SpecSeal Putty, SpecSeal Series SSS Sealant or SpecSeal LCI Sealant

- 3. Fill, Void or Cavity Materials* - Composite Sheet** - Rigid aluminum foil-faced intumescent sheet with steel mesh and galv steel sheet backer. Sheets cut to lap a min of 2 in. (51 mm) on the floor or wall surfaces. Sheet installed on top surface of floor or both surfaces of wall. Sheet to be installed on both surfaces of floor for 3 and 4 hr F Ratings. Sheet to be installed with the galv steel sheet backer exposed (aluminum foil facing against floor or wall surface) and secured to floor or wall surface with min 3/16 in. (5 mm) diam by 1-1/4 in. (32 mm) long steel concrete screws, in conjunction with min 1-1/4 in. (32 mm) diam steel fender washers. Spacing of fasteners not to exceed 6 in. (152 mm) OC.

SPECIFIED TECHNOLOGIES INC - SpecSeal CS Composite Sheet

*Bearing the UL Classification Mark

FOR CANADIAN APPLICATIONS:
When evaluated in accordance with ULC-S115, this system has the following ratings:

System No.	Rating Hr.			
	F	FT	FH	FTH
C-AJ-0113	2	0	2	0

For more information, please see the XHHW7.R14288 section in the UL Fire Resistance Directory entitled Fill, Void or Cavity Materials Certified for Canada.



Specified Technologies Inc. 210 Evans Way Somerville, NJ 08876

Reproduced courtesy of Underwriters Laboratories, Inc.

Created or Revised: October 09, 2009

(800)992-1180 • (908)526-8000 • FAX (908)231-8415 • E-Mail:techserv@stifirestop.com • Website:www.stifirestop.com



C-AJ-0113
PAGE 1 OF 1