




System No. C-AJ-1080

F Rating - 3 Hr

T Rating - 0 Hr

L Rating At Ambient - Less Than 1 CFM/sq ft

L Rating At 400 F - Less Than 1 CFM/sq ft

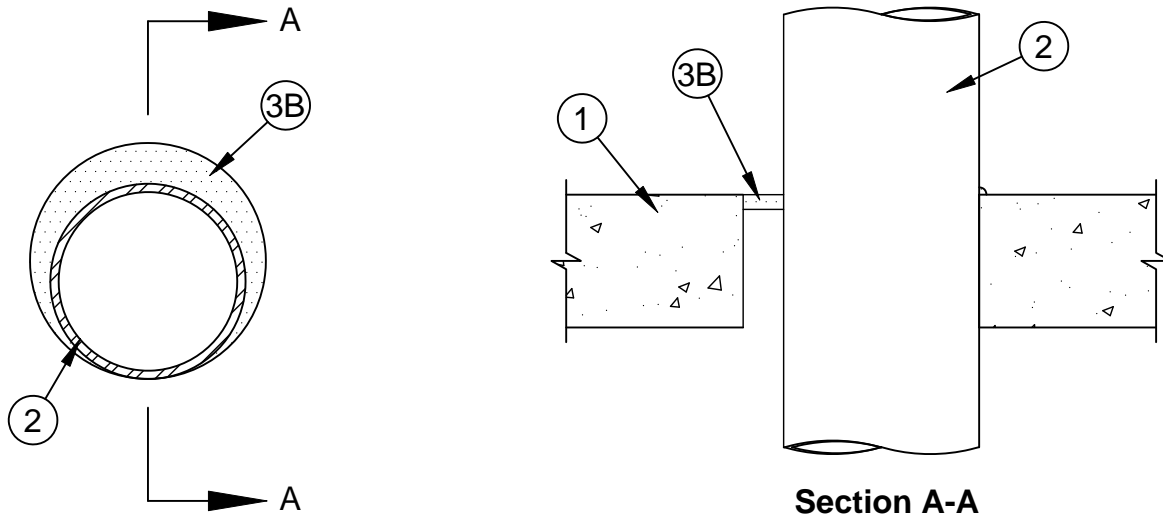

- Floor or Wall Assembly** - Min 4-1/2 in. thick reinforced lightweight or normal weight (100-150 pcf) concrete. Wall may also be constructed of any UL Classified **Concrete Blocks***. Max diam of opening is 32 in.

See **Concrete Block (CAZT)** category in the Fire Resistance Directory for names of manufacturers.

- Through Penetrants** - One metallic pipe, conduit or tubing to be centered within the firestop system. The annular space shall range from min 0 in. (point contact) to max 2 in. Pipe, conduit or tubing to be rigidly supported on both sides of floor or wall assembly. The following types and sizes of metallic pipes, conduits or tubing may be used:

- Steel Pipe** - Nom 30 in. diam (or smaller) Schedule 5 (or heavier) steel pipe.
- Iron Pipe** - Nom 30 in. diam (or smaller) cast or ductile iron pipe.
- Conduit** - Nom 4 in. diam (or smaller) electrical metallic tubing or nom 6 in. diam (or smaller) rigid galv steel conduit.
- Copper Tubing** - Nom 6 in. diam (or smaller) Type M (or heavier) copper tubing.
- Copper Pipe** - Nom 6 in. diam (or smaller) Regular (or heavier) copper pipe.

- Firestop System** - The firestop system shall consist of the following:

- Packing Material** - (Optional, Not Shown) - Mineral wool batt insulation, polyethylene backer rod or glass fiber batt insulation friction fitted into annular space. Packing material to be recessed from top surface of floor or both surfaces of wall as required to accommodate the required thickness of fill material.
- Fill, Void or Cavity Material* - Caulk** - Min 1/2 in. thickness of fill material applied within the annulus, flush with top surface of floor or with both surfaces of wall. At point contact location, apply min 1/4 in. diam bead of sealant at the pipe/concrete interface on the top surface of the floor or both surfaces of wall.

SPECIFIED TECHNOLOGIES INC - SpecSeal Series SSS Sealant or SpecSeal LCI Sealant

*Bearing the UL Classification Mark

FOR CANADIAN APPLICATIONS:

When evaluated in accordance with ULC-S115, this system has the following ratings:

System No.	Rating Hr.			
	F	FT	FH	FTH
C-AJ-1080	3	0	3	0

For more information, please see the XHHW7.R14288 section in the UL Fire Resistance Directory entitled Fill, Void or Cavity Materials Certified for Canada.



Specified Technologies Inc. 210 Evans Way Somerville, NJ 08876

Reproduced courtesy of Underwriters Laboratories, Inc.

Created or Revised: October 09, 2009



(800)992-1180 • (908)526-8000 • FAX (908)231-8415 • E-Mail:techserv@stifirestop.com • Website:www.stifirestop.com

C-AJ-1080
PAGE 1 OF 1